


INSTALLATION PATTERN

(Pattern will vary with selected paver)

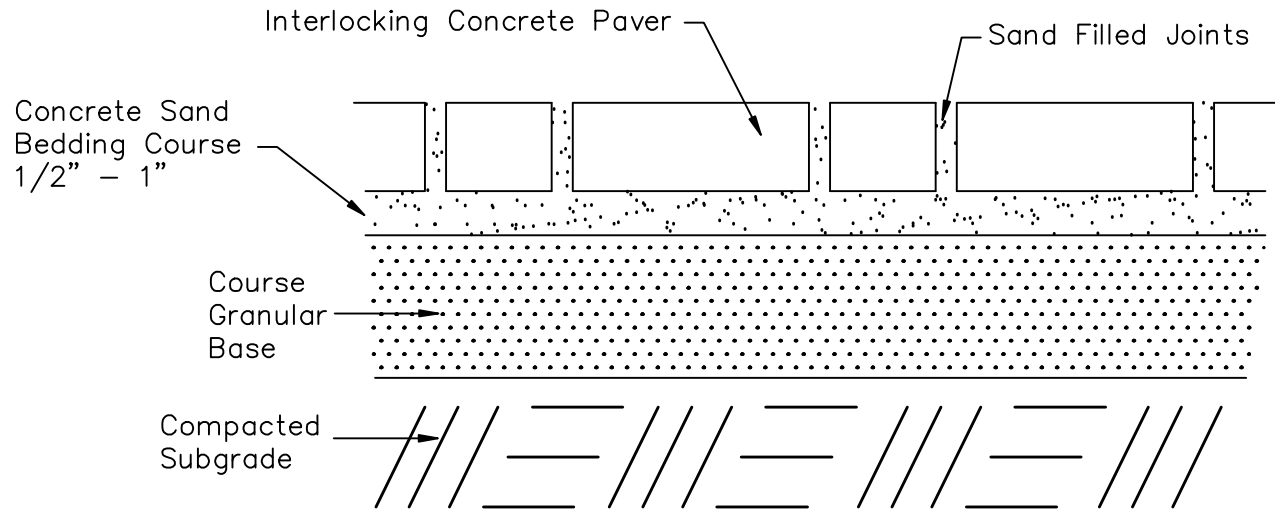

TYPICAL CROSS SECTION

1. Interlocking paving units shall generally be installed in accordance with manufactures requirements.
2. Paver Thickness: 2 3/8" Residential, Light Duty Traffic; 3 1/8" Commercial, Heavy Duty Traffic
3. Concrete Pavers to conform to ASTM C936-82.
4. Course Granular Base shall be in accordance with manufactures requirements (4" min. for 2 3/8" pavers and 8" min. for 3 1/8" pavers). Granular base shall be crushed concrete or other material approved by City Engineer.
5. Coloring or dye shall be uniform throughout each concrete paver unit. Dipped or externally colored paver units are unacceptable.
6. Pavers shall be installed with edge restraint and confined with cemented paver units, curbs, poured concrete or other suitable method.
7. Final finished surface shall be of uniform elevation or slope.
8. Subgrade shall be free of clay, organics, or other materials which will allow future settlement and compacted to 98% AASHTO T-180-57.

INTERLOCKING CONCRETE BLOCK PAVERS

CITY INDEX NO. 113; 1 OF 1
N.T.S.

				CITY OF CLEARWATER, FLORIDA ENGINEERING DEPARTMENT		
				REDRAWN BY E.A.	INTERLOCKING CONCRETE	DATE 01/09
				CHECKED BY GCH	BLOCK PAVERS	INDEX NO. 113
REV.	DATE	DESCRIPTION	APP.	DESIGNED BY TCJ		1 OF 1