
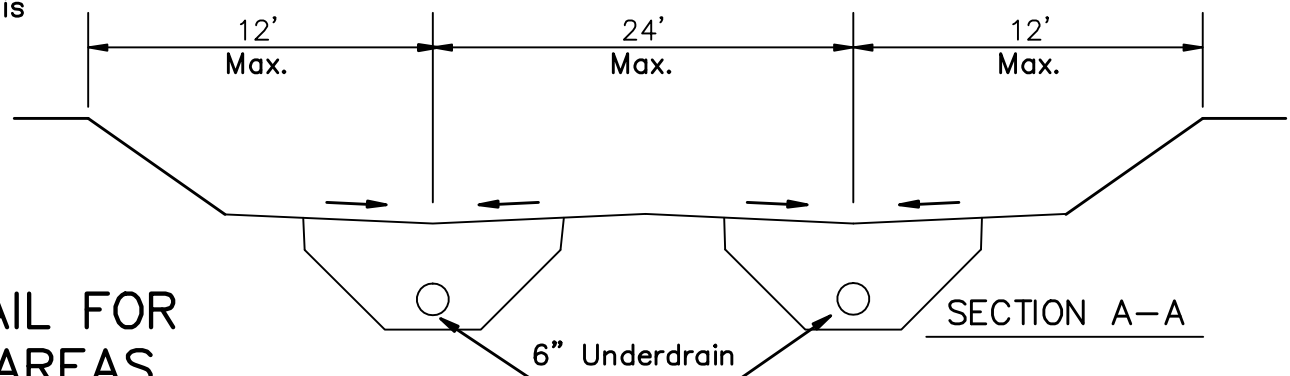


DETENTION POND

NOTES: 1) FDOT standard underdrain is acceptable with 6" minimum pipe.
 2) No ADS pipe shall be used for underdrain on City projects.

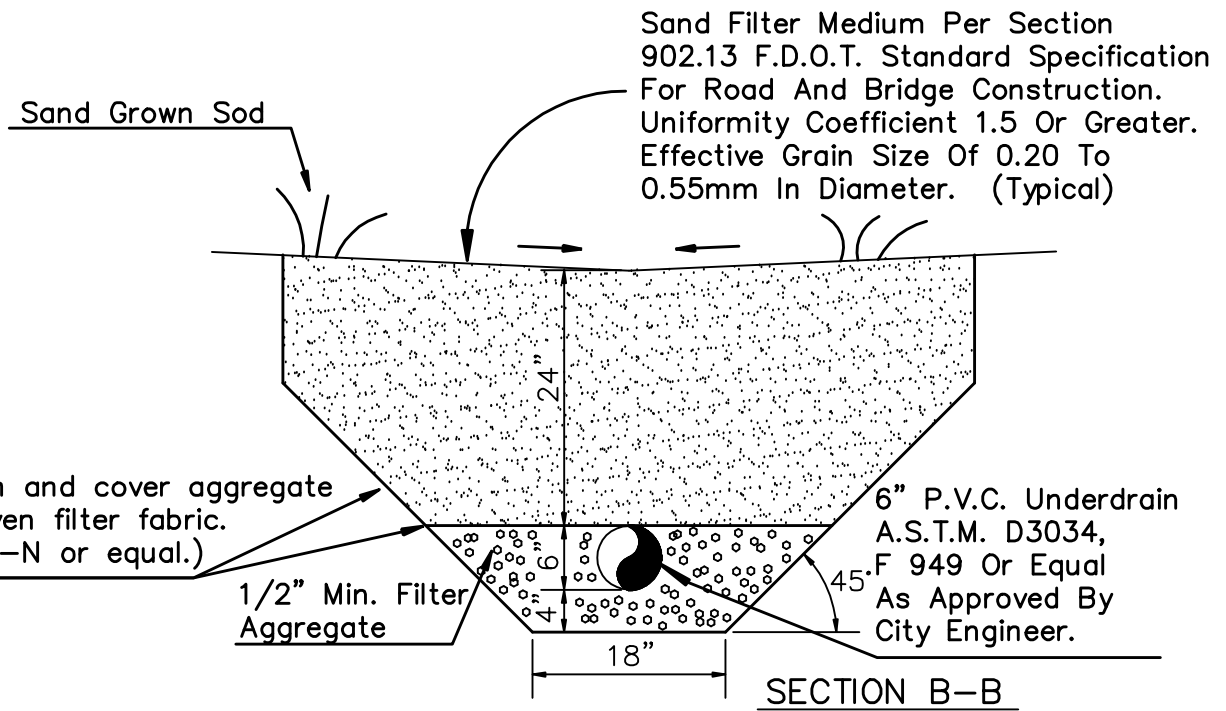

UNDERDRAIN DETAIL FOR DRY DETENTION AREAS

CITY INDEX NO. 217; 1 OF 1
 N.T.S.

				CITY OF CLEARWATER, FLORIDA ENGINEERING DEPARTMENT		
				REDRAWN BY Novo	UNDERDRAIN DETAIL FOR	DATE 01/09
				CHECKED BY W.J.S.	DRY DETENTION AREAS	INDEX NO. 217
				DESIGNED BY R.C.S.		1 OF 1
REV.	DATE	DESCRIPTION	APP.			